

# Memorandum

for the Engineering Committee Meeting of May 19, 2015

**TO:** Engineering Committee Members

**FROM:** Chip Close, Operations Manager  
Shannon Matteoni, Business Services Technician

**DATE:** May 12, 2015

**SUBJECT:** Alderwood Way District Financed Waterline Extension

---

---

## ***OPERATIONS***

**RECOMMENDATION:** Review and evaluate the potential project using District Financed Waterline Extension policy criteria; advise staff as appropriate.


**BACKGROUND:** The District received a petition signed by six (6) landowners to extend treated water from Lake Vera Purdon Road east on Alderwood Way. The area has been mapped using the current policy methods. The project proposes approximately 1,650 lf of 8-inch pipe, potentially serving 10 parcels. The signed petition meets the 60 percent threshold.

As illustrated on the map, there are 7 mainline connections and 3 variance connections. There may be one (1) vacant parcel however this needs to be confirmed. The policy outlines limiting vacant parcels to 20 percent which in this case is two (2).

**BUDGETARY IMPACT:** To be determined.

Attachments (1):

- Area Map

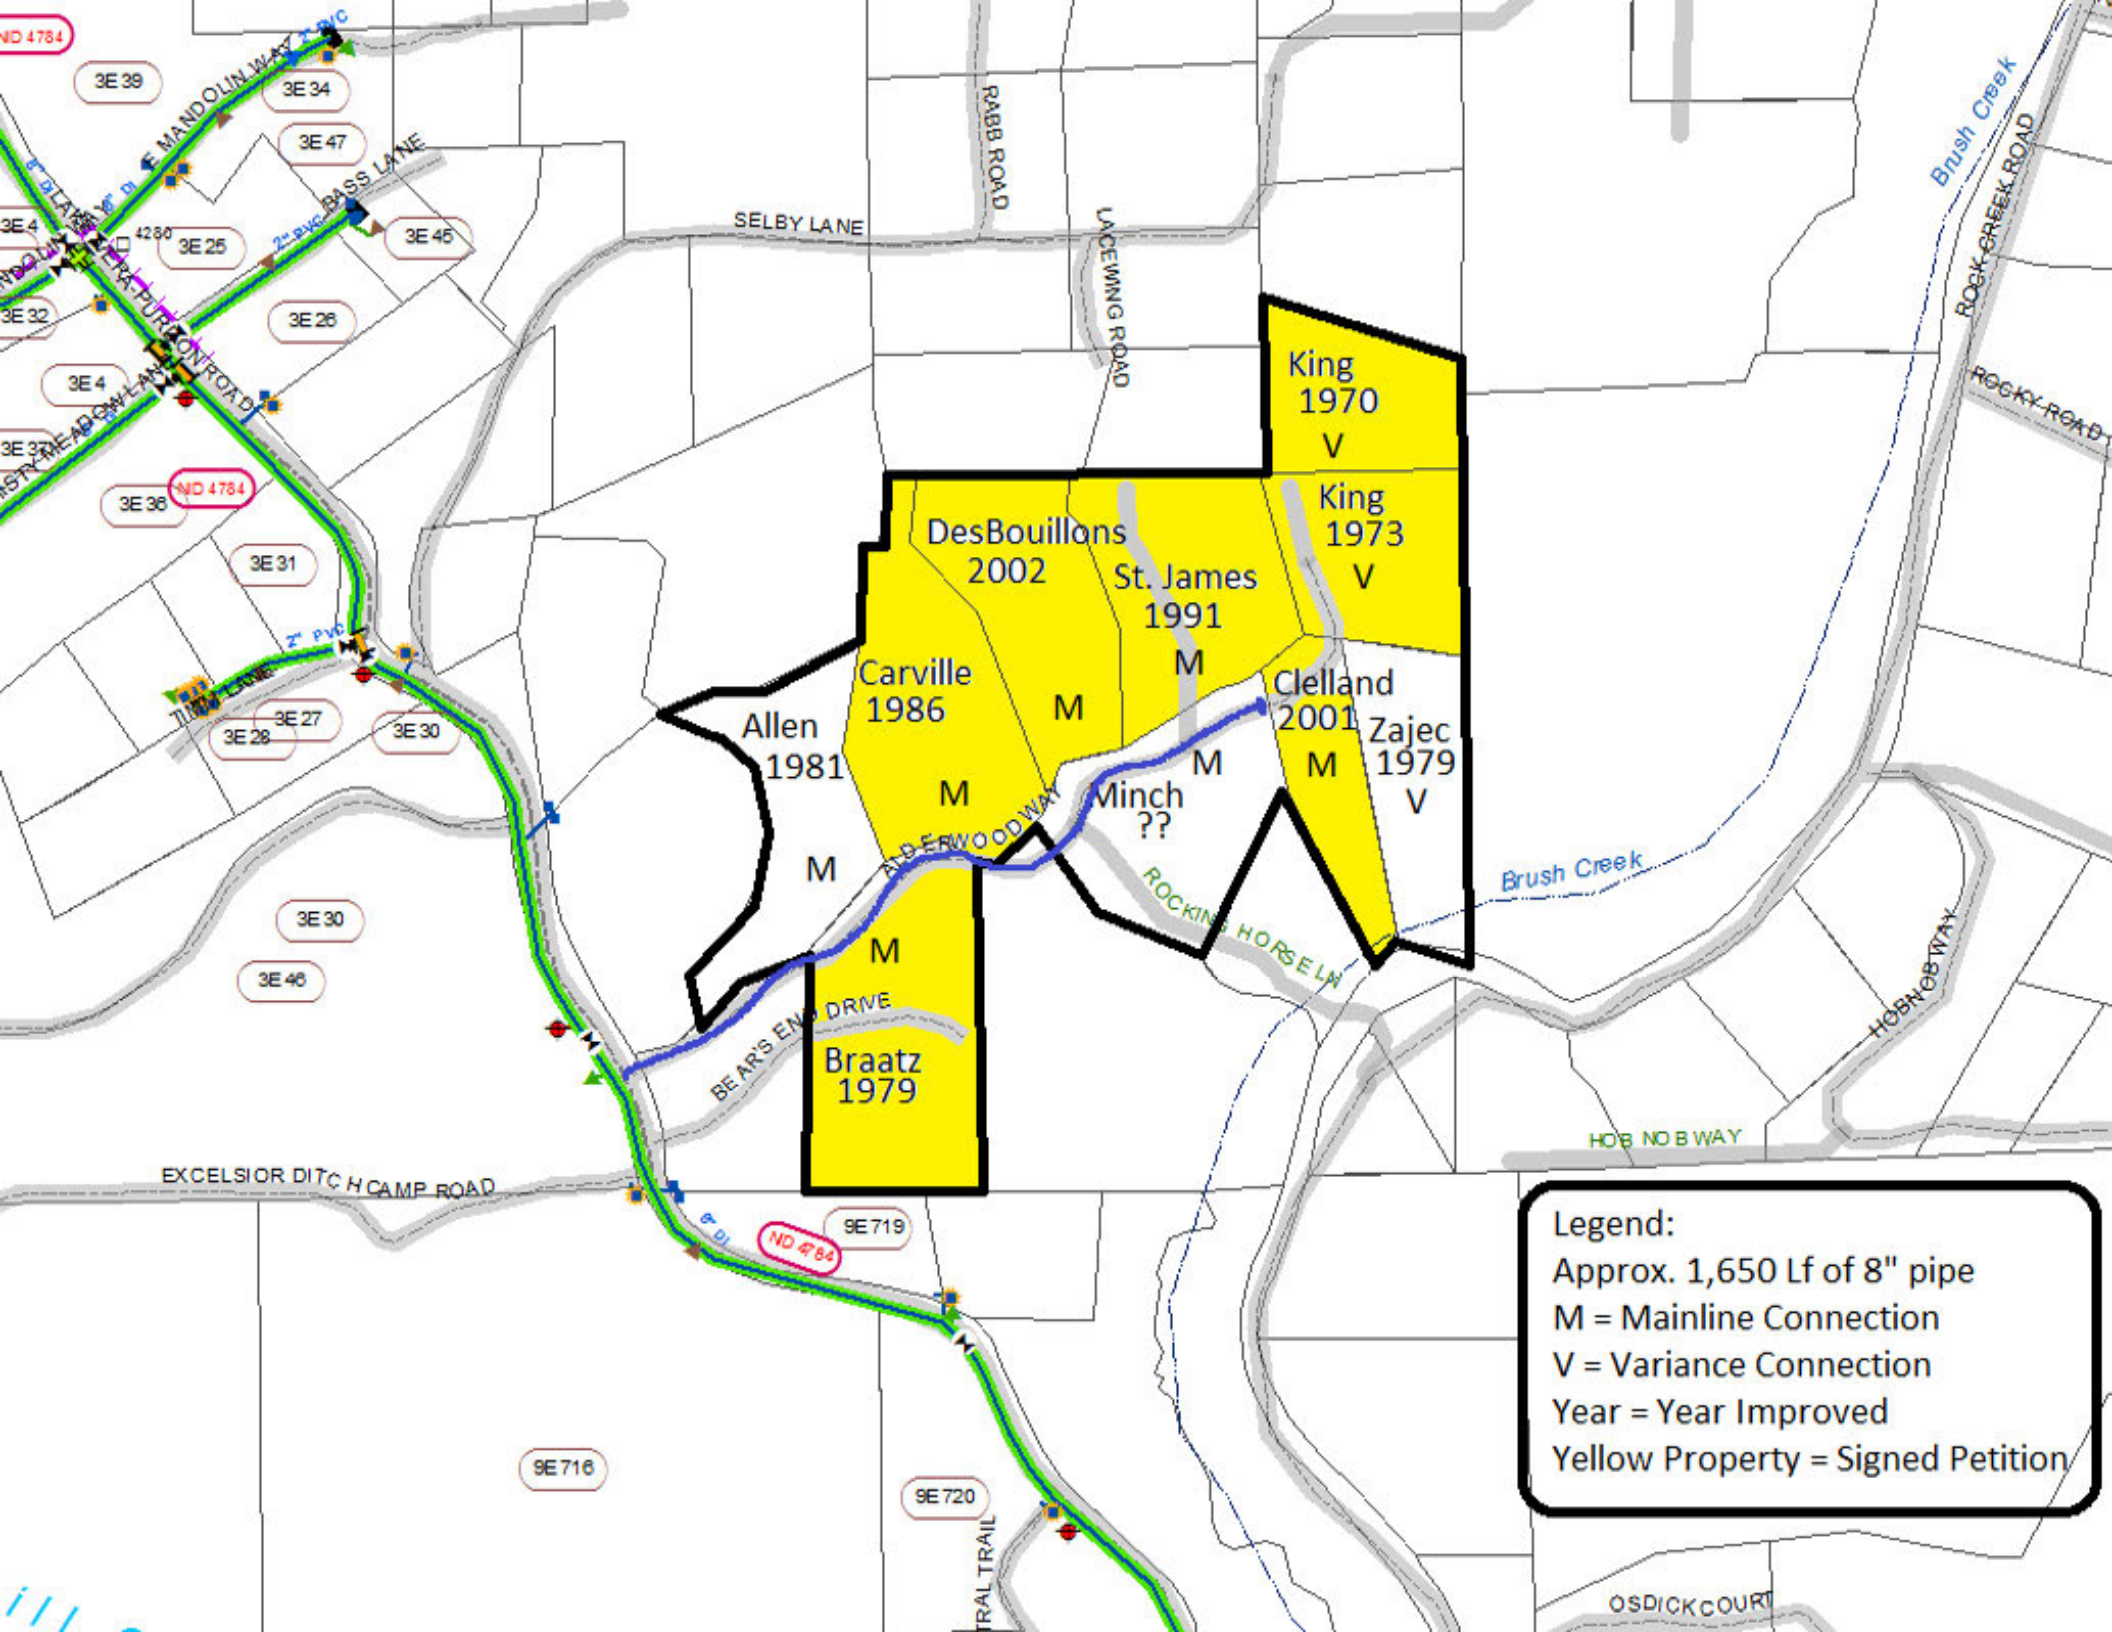

**Legend:**  
 Approx. 1,650 Lf of 8" pipe  
 M = Mainline Connection  
 V = Variance Connection  
 Year = Year Improved  
 Yellow Property = Signed Petition